
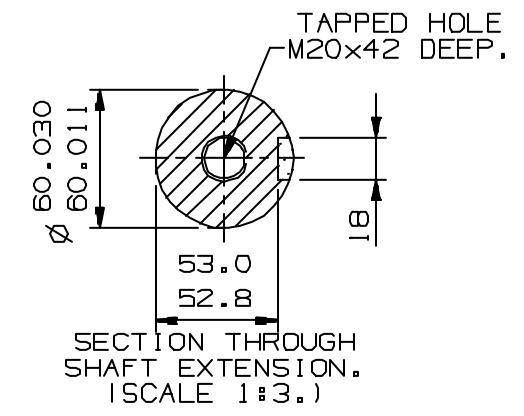
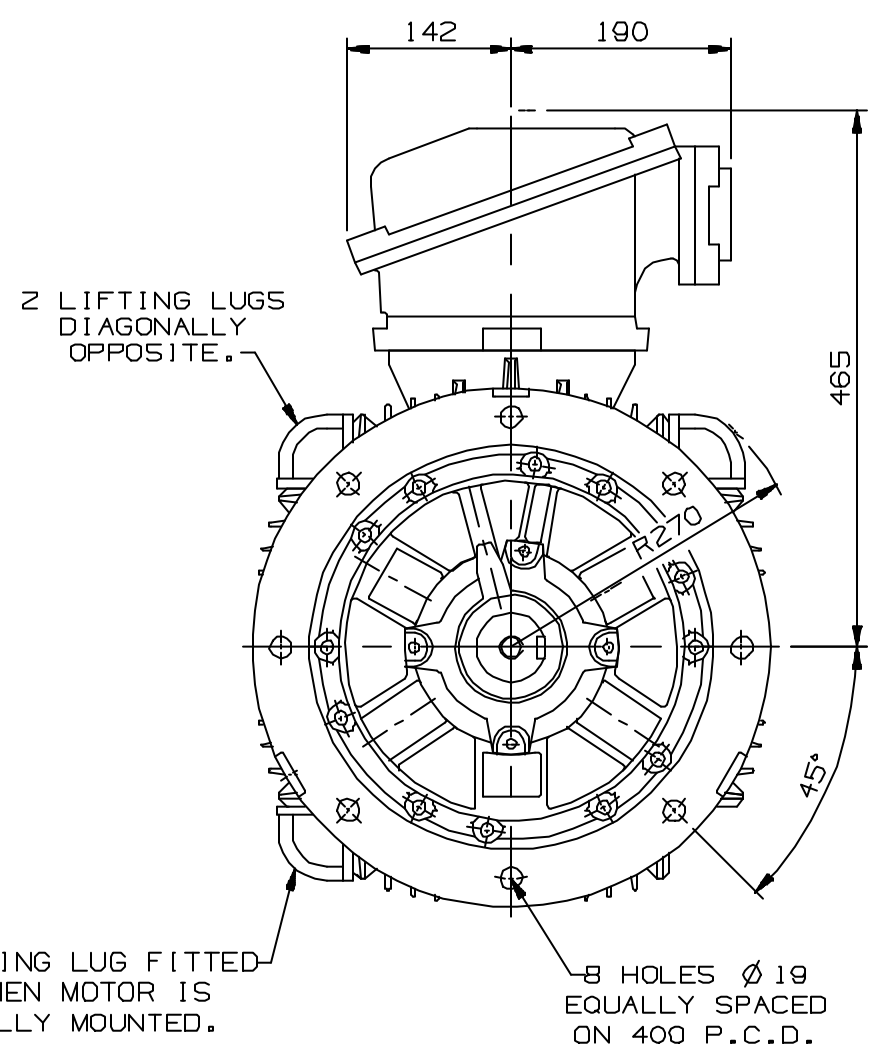


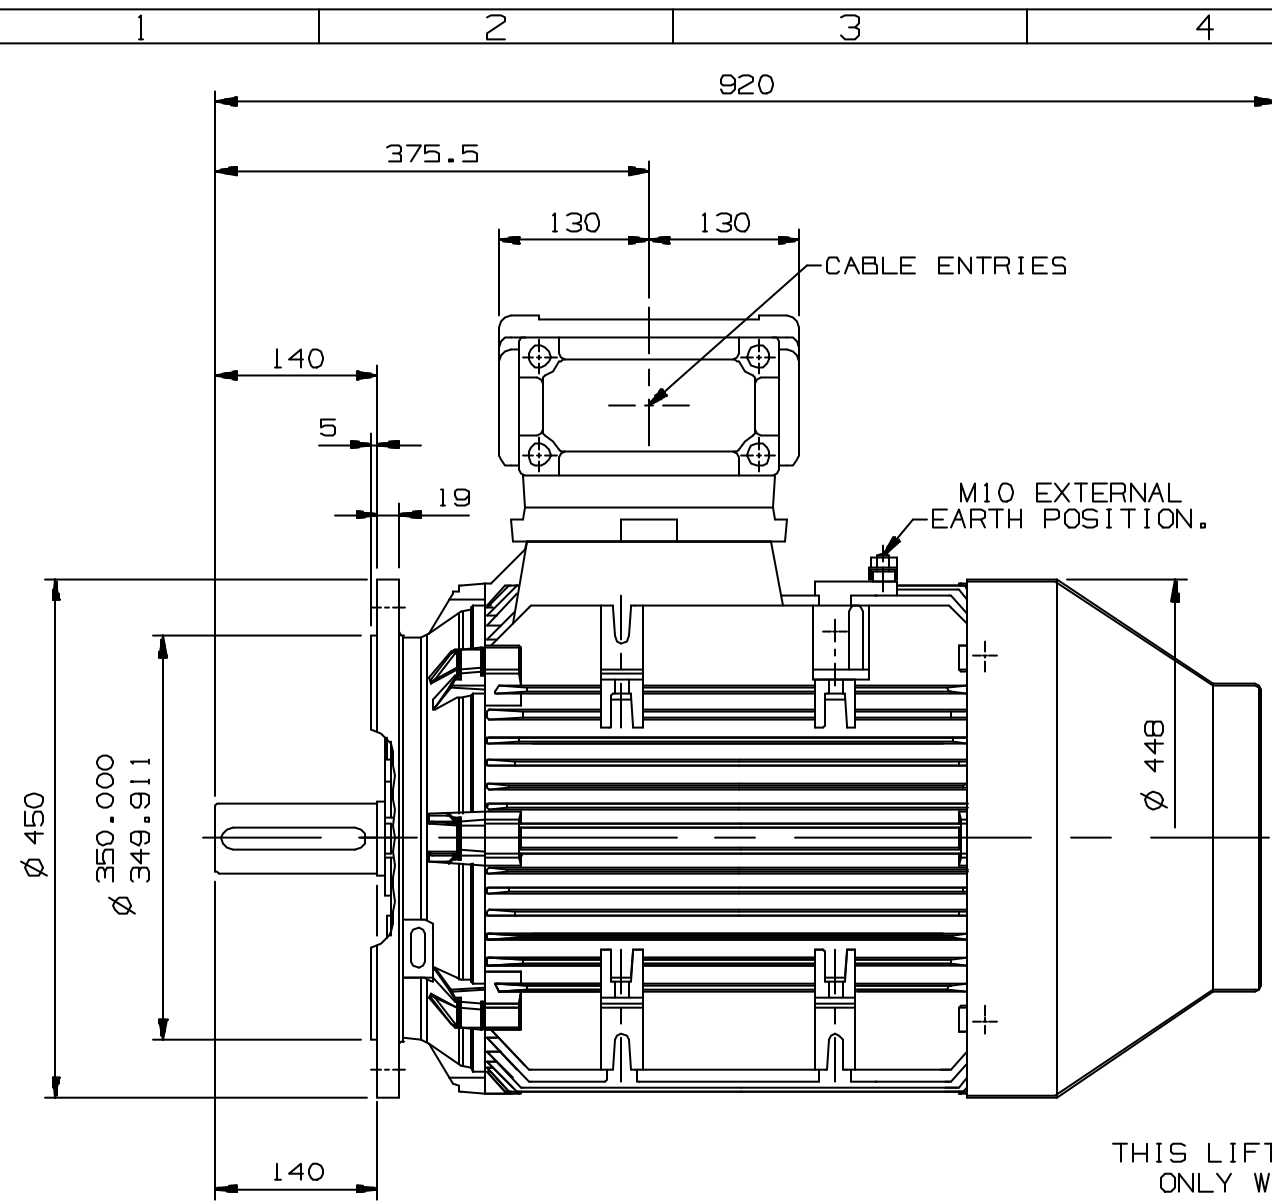

NOTE!
CABLE ENTRY CAN BE SUPPLIED
IN ANY ONE OF FOUR POSITIONS
AT 90° INTERVALS.

NOTE!
STANDARD MACHINES ARE ARRANGED FOR HORIZONTAL OVERHUNG MOUNTING.
CUSTOMERS SHOULD NOTIFY US WHEN ORDERING IF VERTICAL MOUNTING
IS REQUIRED. IF VERTICAL, THE MOTOR THRUST BEARING MUST
NOT BE ALLOWED TO TAKE ANY LOAD OTHER THAN THE WEIGHT OF
THE ROTOR WITHOUT OUR APPROVAL.

NOTE!
2.5 ENDPLAY WILL BE PROVIDED FOR ENDTHRUST
PROTECTION WHEN CUSTOMERS NOTIFY US OF THEIR
INTENTION TO USE RIGID COUPLINGS AND DRIVEN
MACHINES WITHOUT ENDPLAY.

OUTLINE DIMENSIONS OF STANDARD FLANGE MOUNTED METRIC
A.C. MOTOR. EEx de TO EN50014/18/19.
TOTALLY ENCLOSED FAN VENTILATED.
FRAME SIZE: W-EF225M-D (4 POLE UP.)

SCALE	1:6	DATE
DRAWN	M.E	8.9.98
CHECKED	M.B.C	8.9.98
APPROVED	M.B.C	8.9.98

CUSTOMER		
ORDER No.		
SERIAL No.		
ITEM No.		
FRAME SIZE		
KW	R.P.M.	
Hz	PHASE 3	
VOLTS	POLES	
BRGS.	D.E	N.D.E
MOTOR NETT. WT.		Kg.
INSULATION CLASS		
TEMPERATURE RISE		°C
DESIGN AMBIENT TEMPERATURE		°C
HEATER WATTS & VOLTS (IF FITTED)		
WATTS, VOLTS		
REMARKS		
EEx de IIB BASEEFA CERTIFICATE No. BAS02ATEX2115X or EEx de IIC BASEEFA CERTIFICATE No. BAS02ATEX2116X.		
ALL DIMENSIONS IN MILLIMETRES		
FIRST ANGLE PROJECTION		
BROOK CROMPTON		
Large Industrial Motors GUISELEY, LEEDS, LS20 9NZ.		
DRG. No.		M70043
REVISION:	A	M.E DATE 22.7.03